



FLOOR PLAN & 110 VOLT ELECTRICAL SCHEMATIC

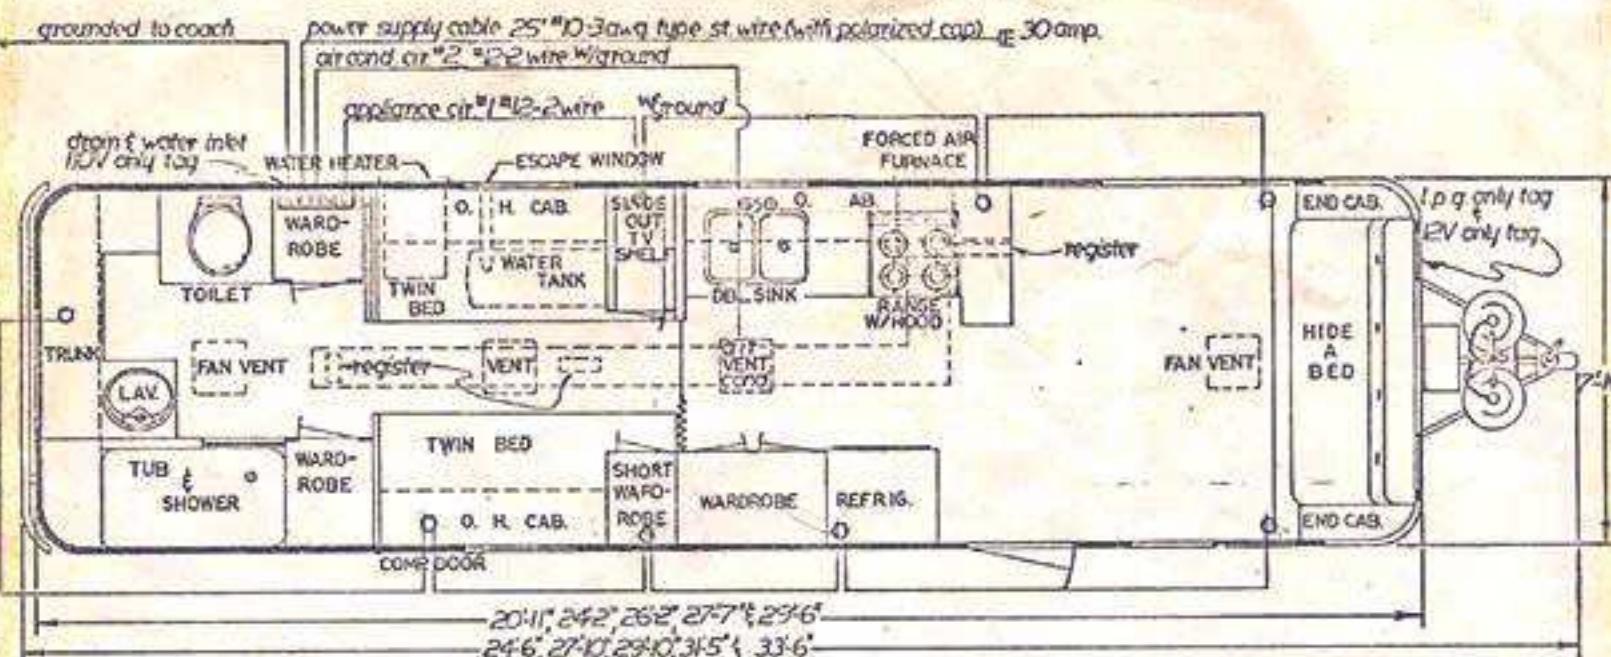

110V convenience outlets provided per non-metallic cable protected per all exposed metal parts grounded back to panel per all receptacles to be grounding type per all aluminum body attached to chassis giving positive ground through-out coach.

appliance / light circuit provided per distribution panel grounded direct to body & chassis - appliances grounded grounding conductors so connected to prevent interruption of ^{per} nec. 210-21(b) - all non current carrying parts grounded per

FLOOR PLAN & 12 VOLT ELECTRICAL SCHEMATIC

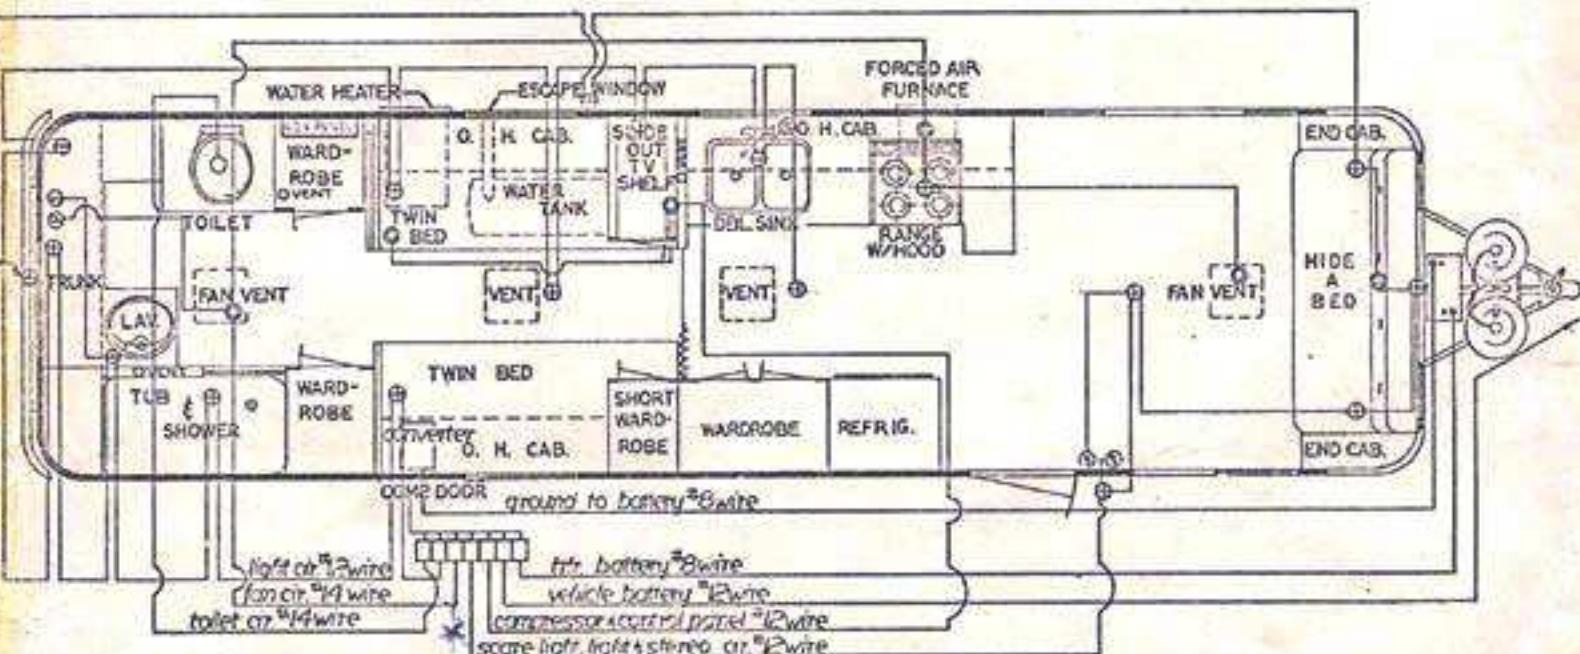

battery circuits shall be separated from other circuits and shall be protected per combustible material per

lighting fixtures shall be protected against lighting in tub enclosure shall be 12 volt. all 12volt wiring is plastic insulated stranded wire.

○ Common Outlet

⊕ Light

○ Fan, Compressor, Control-panel, Stereo

○ Switch

○ Monomatic Toilet